

TO MOUNT UNIT
REMOVE TOP HAT BY
UNSNAPPING FRONT CLIPS

AIR FLOW


UNIT COOLING:
THE UNIT MUST BE INSTALLED
VERTICALLY WITH THE MINIMUM
FREE SPACE.

A3 MOUNTING
BASE


SEE
DETAIL A

A2 MOUNTING
BASE

SEE DETAIL B

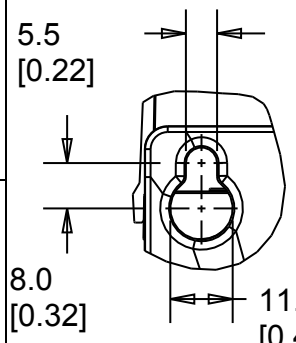

DETAIL A
SCALE 0.750



DETAIL B
SCALE 0.750

FRAME SIZE	HP RANGE		
	208/230V	460V	600V
A2	0.5-3	0.5-5	-
A3	5	7.5-10	0.5-10

-NOTICE- THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY				PRO-E ENTRY BY/DATE: MN 11/03/08	CHECKED BY/DATE:	THE TRANE COMPANY DWG,REF,SUBMITTAL, A2-A3		
				DESIGNED BY/DATE: MN 11/03/08	MFG. APPROVAL BY/DATE:			
LATEST E.C.N. NO.: SP09025				E.C.N. PRO-E ENTRY BY/DATE: DK 6/17/09	APPROVAL:	ENG. APPROVAL BY/DATE:	TITLE:	
PLOT SCALE: NONE				PRO-E FILE:	SHEET: 1	OF: 1	DRAWING NO.:	REV.:
							174N3477	A