

NOTES

- 1. * INDICATES COMPONENTS NOT SUPPLIED BY MANUFACTURER.
- 2. REFER TO THE INSTALLATION AND OPERATION MANUAL FOR DRIVE FUNCTIONS AND PARAMETER SETTINGS.
- BRANCH CIRCUIT PROTECTION, INPUT POWER AND MOTOR WIRING MUST BE SELECTED IN ACCORDANCE WITH THE N.E.C., ANY APPLICATION LOCAL CODES AND THE LOAD CURRENT RATING.
- 4. REPLACE JUMPER 'J1' WITH NORMALLY CLOSED SAFETY INTERLOCK CONTACT AS NECESSARY. CONTACT MUST BE RATED 1/4 HP @ 120VAC MINIMUM.
- 5. PANEL MAY REQUIRE DERATING, CONSULT DRIVE MANUAL OR FACTORY FOR FOLLOWING CONDITIONS:
- 5.1. HIGHER SWITCHING FREQUENCY THEN DRIVE DEFAULT
- 5.2. HIGHER THEN PANEL LISTED AMBIENT TEMPERATURES
- 5.3. ELEVATION ABOVE 3300 FEET (1000 METERS)
- 5.4. LONG MOTOR LEAD LENGTHS
- 6. WHEN MOTOR OVERLOADS SIZES ARE DIFFERENT, MOTOR 1 WILL BE THE LARGER OF THE TWO MOTORS

WARNING!
THE FOLLOWING TABLE LIST THE PARAMETERS THAT ARE SET DIFFERENT FROM THE DRIVE DEFAULT SETTINGS.
ADDITIONAL PARAMETER SETTINGS MAY BE REQUIRED FOR YOUR APPLICATION.

DRIVE PARAMETER SETTINGS

| PARAMETER # | NAME | SETTING | VALUE |
|-------------|-------------------|---------|--------------------|
| 0-02 | MOTOR SPEED UNIT | 1 | HZ |
| 0-03 | REGIONAL SETTINGS | 1 | NORTH AMERICA |
| 1-03 | TORQUE CHAR. | 1 | VARIABLE TORQUE |
| 5-02 | TERMINAL 29 TYPE | 1 | OUTPUT |
| 5-31 | TERMINAL 29 | 5 | RUNNING |
| 14-20 | RESET MODE | 13 | INFINITE AUTO REST |
| | | | |
| | | | |

| В | | | -NOTICE- | DRN | NAME | N | EMA 3R,600V,2C | THE TRANE COMPANY |
|-----|------------|------|---|-----|-------|-------|--------------------|--------------------------------------|
| Α | | | THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO | DTM | | • | N DISC,DRIVE FUSE | A DIVISION OF AMERICAN STANDARD INC. |
| DR | ECNSP09001 | 1/09 | OUTSIDE PARTIES WITHOUT THE WRITTEN | APR | MODEL | ,SMB2 | 2,DUAL MOTOR,1 FAN | 7 4 5 1 4 0 0 0 |
| REV | ECN | DATE | CONSENT OF THE TRANE COMPANY | DTM | MODEL | VLT | PAGE 1 OF 2 | 4N4229 |



TERMINAL IDENTIFCATION

X - DRIVE TREMINAL


O - CUSTOMER TERMINAL


CUSTOMER DRY CONTACT RATINGS

| RELAY | CONTACT RATING | |
|--------|---------------------------------|--|
| CR6 | 5A @ 120VAC 1/10 HP @ 120VAC | |
| M2, M3 | 10A @ 120/240VAC | |

CONTACT SEQUENCE CHART FOR S1

| X INDICATES CONTACT CLOSED | | | | |
|----------------------------|-------|-----|--------|--|
| POSITION | | | | |
| CONTACT | DRIVE | OFF | BYPASS | |
| 13-14 | | | Χ | |
| 23-24 | X | | | |

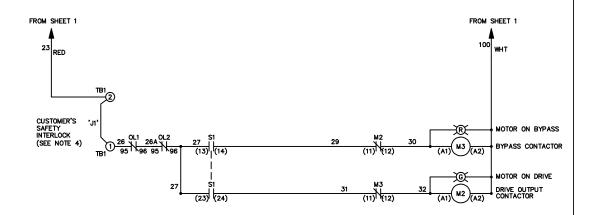

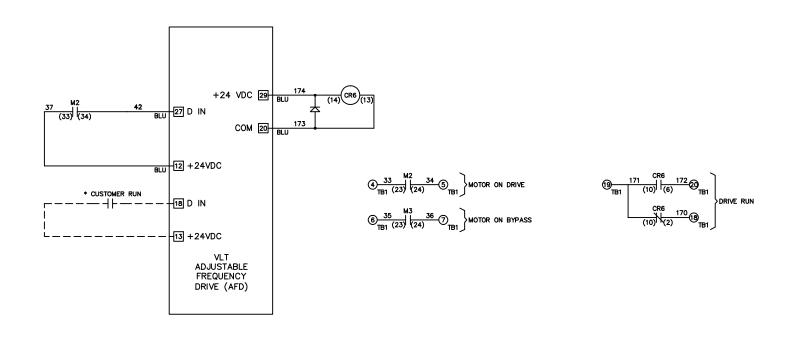

| В | | |
|-----|------------|------|
| Α | | |
| DR | ECNSP09001 | 1/09 |
| REV | ECN | DATE |

-NOTICE-THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY

| DTM | NAME | ,MAI | EMA 3R,600V,20 N DISC,DRIVE F 2.DUAL MOTOR.1 | USE |
|-----|-------|---------|--|------|
| APR | 1 | ,JIVID2 | L,DUAL MUTUR, | FAIN |
| DTM | MODEL | VLT | PAGE <u>2</u> OF <u>2</u> | SIZE |

| THE | TRANE | E COMP | ANY |
|------|-------|--------------------|------|
| AMER | | SION OF TANDARD | INC. |